



# Smoke and Dye-Water Observation Summary

Western Run Pilot Project - Baltimore Maryland

## FIELD SKETCH

Dye Test 221

Page 1 of 2  
Smoke Set No. 13  
Setup No. 6



### BUREAU OF WATER AND WASTEWATER SMOKE TEST INSPECTION FORM

TEST LOCATION			
Project: WRPA	Sewershed: Jones Falls	Date: 10/5/04	Start Time: 1715
Crew: T2	Street Location: Williamson Ave.	Number of Segments: 4	Test Length: 1124'
US MH: 1521170	DS MH: 1522093	# of Blowers: 1 @ 3	Ground: (Dry) Moderate Wet
Plugged US: (Y) N	Plugged DS: (Y) N	Comments:	
Plugs Removed? (Y) N	Recorder: Bob Bisk		



MH04AA2-020

Dye Flooded this  
Catch Basin

Defect B2

MH 04AA2-022

MH 04AA2-010

CREW COMMENTS

Last Revised 10/5/2004

Leader Form

Sketch No: 221

Filename Path:

X:\Baltimore City\Western Run Pilot Area - Data Files\Smoke  
Testing\Pictures\Sketches\221.tif

Image Status: Image found and displayed.


NOTE: Sanitary sewer alignments and connectivity  
in the Western Run GIS have been revised  
following smoke testing to reflect updated  
information from various sources and may no longer  
match the field sketches shown.

# DYE TESTING FORM

Sketch (NTS)

Dye Test 221

Show North Arrow

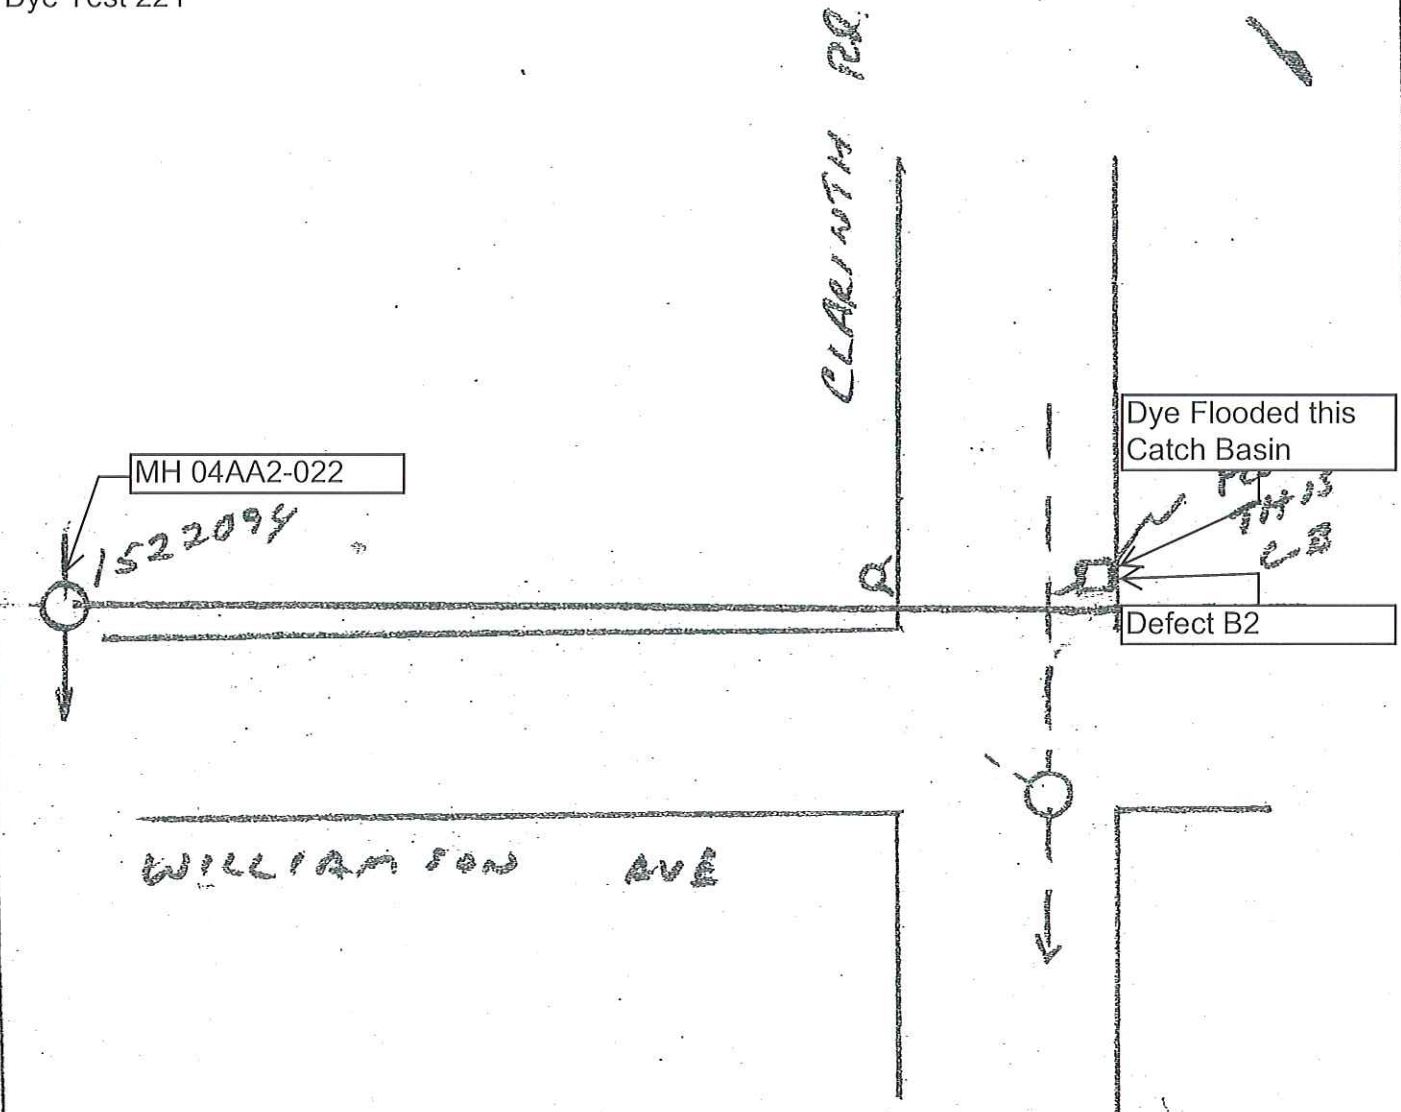

RESULTS	SOURCE TYPE CODES			
1. POSITIVE	1. MAIN SEWER	5. DOWN SPOUT	9. STAIRWELL DRAI	13. STORM DRAIN
2. NEGATIVE	2. SERVICE LINE	6. DWNSPT CONN.	10. FOUNDATION DRAIN	14. CATCH BASIN
3. CANNOT TEST	3. TRANSITION JOIN	7. AREA DRAIN	11. BUILDING INTERIOR	15. STORM MH
	4. CLEAN OUT	8. DRIVEWAY DRAIN	12. MH FRAME/SEAL	16. STORM DITCH
Additional Comments: <b>COULD NOT PLUG ANY THING</b>				
<b>NO DYE SEEN IN SAN. SEWER</b>				